work of providing, laying 100mm dia DI water supply pipeline in place of 75mm/100mm dia,corroded CI line in 5th cross,6th cross siddarthanagara,patelgalli,ittige anjanappa lane 2nd cross and surrounding areas to reduce contamination and freequent leak under Jagajeevanram nagar Service station of AEE SW2 Sub-Division area:

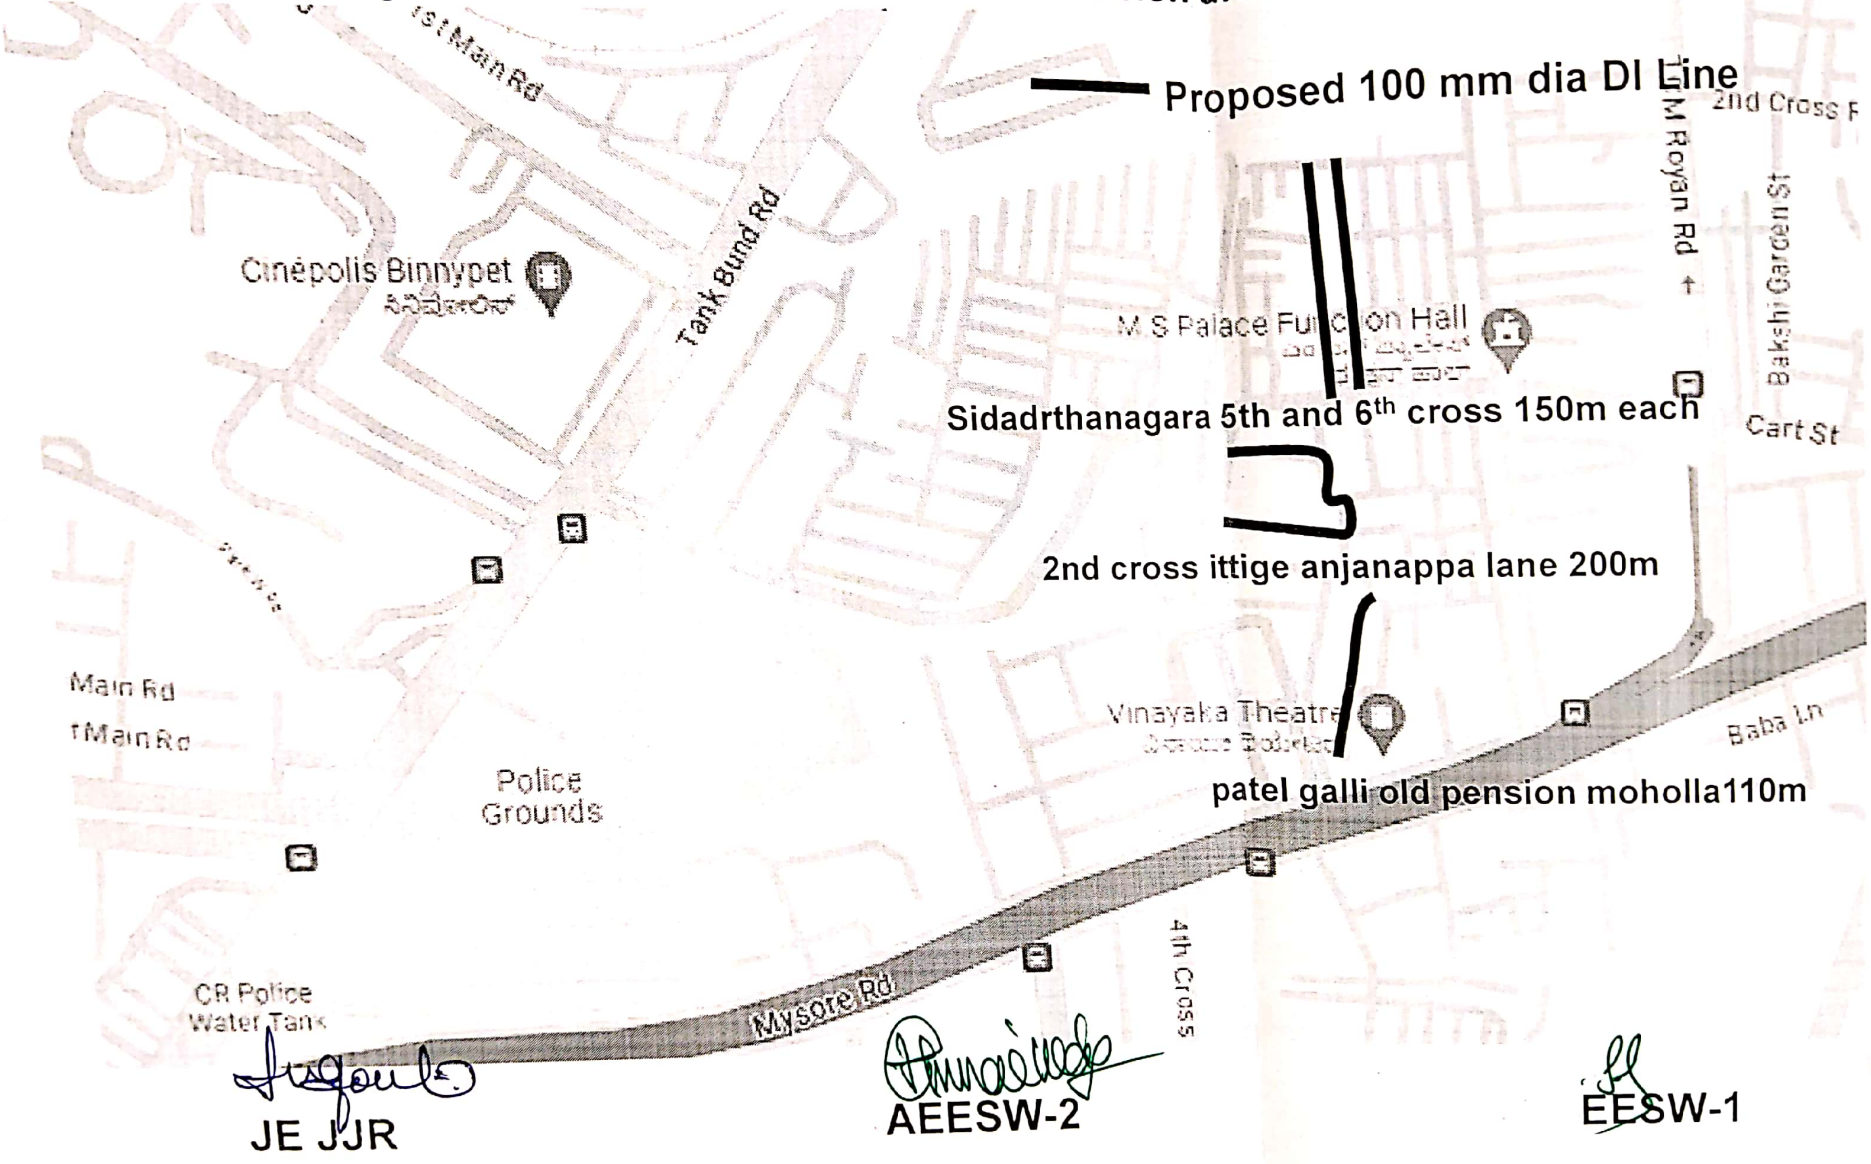

JE JJR

AEESW-2

EESW-1

Scanned with OKEN Scanner

work of providing, laying 100mm dia DI water supply pipeline in place of 75mm/100mm dia,corroded CI line in 5th cross,6th cross siddarthanagara,patelgalli,ittige anjanappa lane 2nd cross and surrounding areas to reduce contamination and freequent leak under Jagajeevanram nagar Service station of AEE SW2 Sub-Division area:

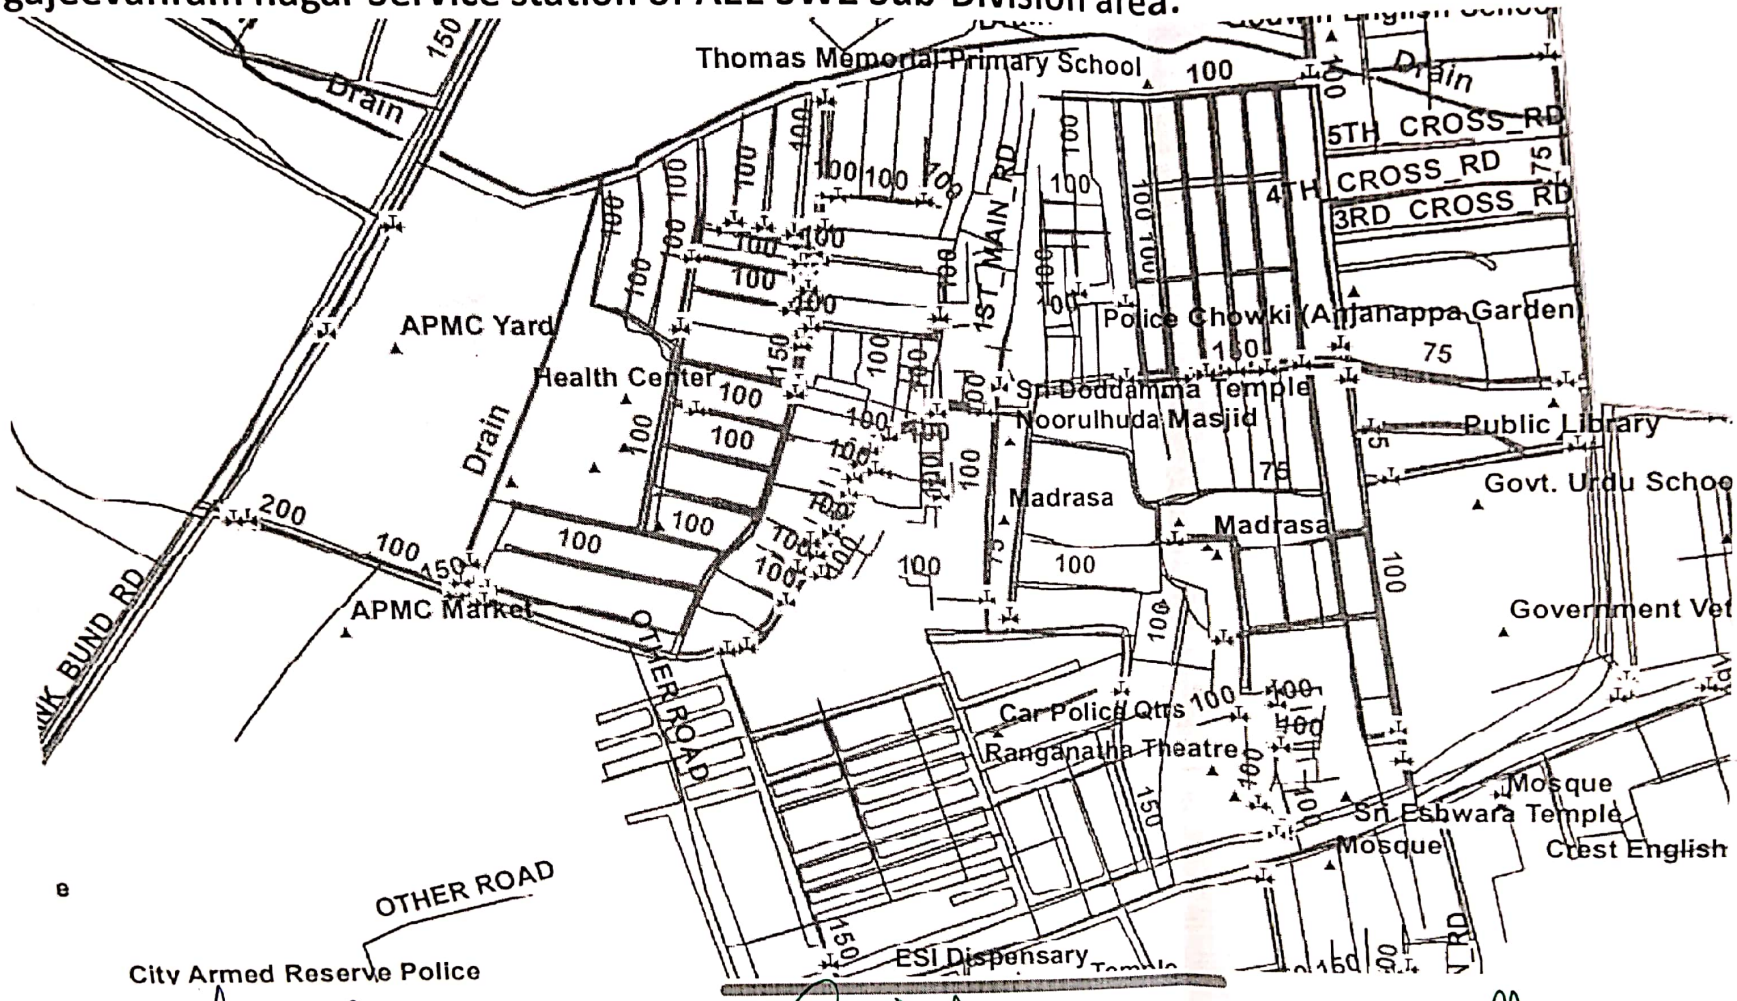

JE JJR

AEESW-2

EESW-1

Scanned with OKEN Scanner